

WATER TANK CLEANING & DISINFECTION

@

ST. JOSEPH'S SCHOOL



GENIUS CLEANING SERVICES LLC-SPC

**REPORT
TO**

SAINT JOSEPH'S SCHOOL, ABU DHABI, UAE

DATE OF CLEANING: 25 OCTOBER 2025

NEXT CLEANING: 24 APRIL 2026

*Prepared By
Genius Cleaning Services LLC-SPC
Abu Dhabi
0529287635*



العبقرية لخدمات التنظيف GENIUS CLEANING SERVICES

CLEANING & DISINFECTION CERTIFICATE

POTABLE WATER TANKS

CLIENT NAME : SAINT JOSEPH'S SCHOOL
CLIENT ADDRESS : ABU DHABI, UAE
CONTACT PERSON : Mr : MARTIN
SITE DETAILS : ST. JOSEPH'S SCHOOL
SERVICE DETAILS : WATER TANK CLEANING & DISINFECTION
DATE OF CLEANING : 25 OCTOBER 2025
FREQUENCY OF CLEANING : EVERY SIX MONTHS
DATE OF NEXT CLEANING : 24 APRIL 2026

The procedures employed in this cleaning and disinfection comply with HS (G)70 health and safety guidelines for prevention of Legionella as well as BS6700 and CARELA BIO LUS method statement.

The entire water storage Tank (TANK-01 Nos & WATER COOLER-5) should be cleaned and disinfected minimum every six (6) months depending upon the conditions.



GENIUS CLEANING SERVICES LLC-SPC



العبقرية لخدمات التنظيف GENIUS CLEANING SERVICES

Ref.No:1422/2025

Water Tank Cleaning Completion Certificate

Customer Name	ST.JOSEPH'S SCHOOL,ABU DHABI	Reported Date	26.10.2025
Contact Name	Mr. MARTIN	Contact No.	
Location : ST.JOSEPH'S SCHOOL			
Specification of Tank: ROOF WATER TANK -1		Disinfectant used: CARELA PLUS CARELA BIO	
☐ Concrete Uncoated ☐ Molded Fiber Glass ☒ GRP Panel ☐ Steel			
☐ Concrete Coated ☐ TILES ☐ P E ☐ Others			
Size of tank: 10 M3			
Quantity of Water ☐ Full ☐ Half Full ☒ Empty			
Condition of Tank before Cleaning ☐ Clean ☒ Dirty ☐ Very Dirty			
Bio-Film ☐ Yes ☒ No		Sediment ☒ Yes ☐ No	
Mould / Algae ☐ Yes ☒ No		Stains ☒ Yes ☐ No	
Lid / Covers Fitted ☒ Yes ☐ No ☐ Damaged			
Leaks ☐ Yes ☒ No Vent Screen present Yes ☐ No ☐ N/A			
Vent Screens Installed ☐ Yes ☐ No ☐ N/A			
Pumps Working ☒ Yes ☐ No		Valves Working ☐ Yes ☐ No	
Pipes ☐ Galvanized ☐ UPVC ☐ Copper		Tank fitted with a Drain ☒ Yes ☐ No	
Access			
Ladder Inside ☒ Yes ☐ No Ladder Outside ☒ Yes ☐ No			
Team Members(Name)		Time Started	Time Finished
1.RENJITH		02.00 PM	03.00 PM
2.SUJITH			
3.AJITH			
4.RAJESH			
Cleaning and Disinfection carried out for the tank.			
Disinfection will be effective for 6 months from the date of execution of process depending on the conditions			
Last Date of cleaning		Current Date of cleaning	Next Date of cleaning
		25.10.2025	24.04.2026
 Signed for Genius Cleaning Services		Signed for Client	



GENIUS CLEANING SERVICES LLC-SPC

DATE:25.10.2025

ST.JOSEPH'S PRIVATE SCHOOL -ABU DHABI-ROOF WATER TANK-1

BEFORE CLEANING



AFTER CLEANING



Tel: 02-5559683, Fax: 02-5526433, P.O.Box : 132952, Abu Dhabi, UAE

E-mail: geniuscleaninguae@gmail.com



العبقرية لخدمات التنظيف GENIUS CLEANING SERVICES

Ref.No:1423/2025

Water Tank Cleaning Completion Certificate



Customer Name	ST.JOSEPH'S SCHOOL,ABU DHABI	Reported Date	26.10.2025
Contact Name	Mr. MARTIN	Contact No.	
Location : ST.JOSEPH'S SCHOOL			
Specification of Tank: ROOF WATER TANK -2		Disinfectant used: CARELA PLUS CARELA BIO	
☐ Concrete Uncoated ☐ Molded Fiber Glass ☒ GRP Panel ☐ Steel			
☐ Concrete Coated ☐ TILES ☐ P E ☐ Others			
Size of tank: 10 M3			
Quantity of Water ☐ Full ☐ Half Full ☒ Empty			
Condition of Tank before Cleaning ☐ Clean ☒ Dirty ☐ Very Dirty			
Bio-Film ☐ Yes ☒ No		Sediment ☒ Yes ☐ No	
Mould / Algae ☐ Yes ☒ No		Stains ☒ Yes ☐ No	
Lid / Covers Fitted ☒ Yes ☐ No ☐ Damaged			
Leaks ☐ Yes ☒ No		Vent Screen present Yes ☐ No ☐ N/A	
Vent Screens Installed ☐ Yes ☐ No ☐ N/A			
Pumps Working ☒ Yes ☐ No		Valves Working ☐ Yes ☐ No	
Pipes ☐ Galvanized ☐ UPVC ☐ Copper		Tank fitted with a Drain ☒ Yes ☐ No	
Access			
Ladder Inside ☒ Yes ☐ No		Ladder Outside ☒ Yes ☐ No	
Team Members(Name)		Time Started	Time Finished
1.RENJITH		03.00 PM	04.00 PM
2.SUJITH			
3.AJITH			
4.RAJESH			
Cleaning and Disinfection carried out for the tank.			
Disinfection will be effective for 6 months from the date of execution of process depending on the conditions			
Last Date of cleaning		Current Date of cleaning	Next Date of cleaning
		25.10.2025	24.04.2026
 Signed for Genius Cleaning Services		Signed for Client	



GENIUS CLEANING SERVICES LLC-SPC

DATE:25.10.2025

ST.JOSEPH'S PRIVATE SCHOOL -ABU DHABI-ROOF WATER TANK-02

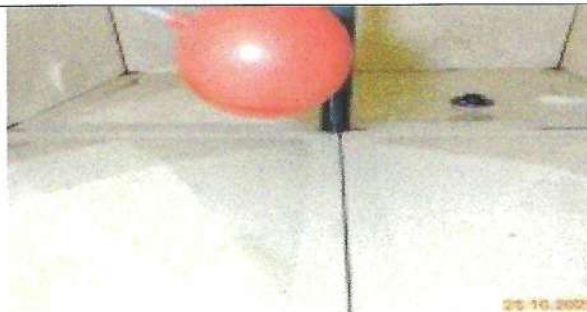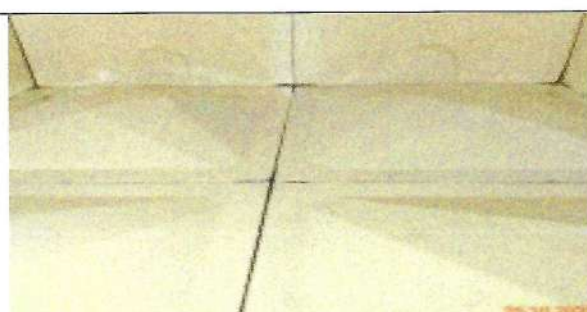BEFORE CLEANING	AFTER CLEANING
 25.10.2025	 25.10.2025
 25.10.2025	 25.10.2025
 25.10.2025	 25.10.2025



Tel: 02-5559683, Fax: 02-5526433, P.O.Box : 132952, Abu Dhabi, UAE

E-mail: geniuscleaninguae@gmail.com



العبقرية لخدمات التنظيف GENIUS CLEANING SERVICES

Ref.No:1424/2025

Water Tank Cleaning Completion Certificate

Customer Name	ST.JOSEPH'S SCHOOL,ABU DHABI	Reported Date	26.10.2025
Contact Name	Mr. MARTIN	Contact No.	
Location : ST.JOSEPH'S SCHOOL			
Specification of Tank: UNDERGROUND WATER TANK PART-1		Disinfectant used: CARELA PLUS CARELA BIO	
☐ Concrete Uncoated ☐ Molded Fiber Glass GRP Panel ☐ Steel			
☒ Concrete Coated ☐ TILES ☐ P E ☐ Others			
Size of tank: 16.5 M3			
Quantity of Water ☐ Full ☐ Half Full ☒ Empty			
Condition of Tank before Cleaning ☐ Clean ☒ Dirty ☐ Very Dirty			
Bio-Film ☐ Yes ☒ No		Sediment ☒ Yes ☐ No	
Mould / Algae ☐ Yes ☒ No		Stains ☒ Yes ☐ No	
Lid / Covers Fitted ☒ Yes ☐ No ☐ Damaged			
Leaks ☐ Yes ☒ No		Vent Screen present Yes ☐ No ☐ N/A	
Vent Screens Installed ☐ Yes ☐ No ☐ N/A			
Pumps Working ☒ Yes ☐ No		Valves Working ☐ Yes ☐ No	
Pipes ☐ Galvanized ☐ UPVC ☐ Copper		Tank fitted with a Drain ☒ Yes ☐ No	
Access			
Ladder Inside ☒ Yes ☐ No		Ladder Outside ☒ Yes ☐ No	
Team Members(Name)		Time Started	Time Finished
1.RENJITH		04.00 PM	05.00 PM
2.SUJITH			
3.AJITH			
4.RAJESH			
Cleaning and Disinfection carried out for the tank. Disinfection will be effective for 6 months from the date of execution of process depending on the conditions			
Last Date of cleaning		Current Date of cleaning	Next Date of cleaning
		25.10.2025	24.04.2026
Signed for Genius Cleaning Services		Signed for Client	



GENIUS CLEANING SERVICES LLC-SPC

DATE:25.10.2025

ST.JOSEPH'S PRIVATE SCHOOL -ABU DHABI-UNDERGROUND WATER TANK-1

BEFORE CLEANING	AFTER CLEANING
	
	
	



Tel: 02-5559683, Fax: 02-5526433, P.O.Box : 132952, Abu Dhabi, UAE

E-mail: geniuscleaninguae@gmail.com



العبقرية لخدمات التنظيف GENIUS CLEANING SERVICES

Ref.No:1425/2025

Water Tank Cleaning Completion Certificate

Customer Name	ST.JOSEPH'S SCHOOL,ABU DHABI	Reported Date	26.10.2025
Contact Name	Mr. MARTIN	Contact No.	
Location : ST.JOSEPH'S SCHOOL			
Specification of Tank: UNDERGROUND WATER TANK PART-2		Disinfectant used: CARELA PLUS CARELA BIO	
☐ Concrete Uncoated ☐ Molded Fiber Glass GRP Panel ☐ Steel			
☒ Concrete Coated ☐ TILES ☐ P E ☐ Others			
Size of tank: 16.5 M3			
Quantity of Water ☐ Full ☐ Half Full ☒ Empty			
Condition of Tank before Cleaning ☐ Clean ☒ Dirty ☐ Very Dirty			
Bio-Film ☐ Yes ☒ No		Sediment ☒ Yes ☐ No	
Mould / Algae ☐ Yes ☒ No		Stains ☒ Yes ☐ No	
Lid / Covers Fitted ☒ Yes ☐ No ☐ Damaged			
Leaks ☐ Yes ☒ No Vent Screen present Yes ☐ No ☐ N/A			
Vent Screens Installed ☐ Yes ☐ No ☐ N/A			
Pumps Working ☒ Yes ☐ No		Valves Working ☐ Yes ☐ No	
Pipes ☐ Galvanized ☐ UPVC ☐ Copper		Tank fitted with a Drain ☒ Yes ☐ No	
Access			
Ladder Inside ☒ Yes ☐ No Ladder Outside ☒ Yes ☐ No			
Team Members(Name)		Time Started	Time Finished
1.RENJITH		05.00 PM	06.00 PM
2.SUJITH			
3.AJITH			
4.RAJESH			
Cleaning and Disinfection carried out for the tank.			
Disinfection will be effective for 6 months from the date of execution of process depending on the conditions			
Last Date of cleaning	Current Date of cleaning	Next Date of cleaning	
	25.10.2025	24.04.2026	
Signed for Genius Cleaning Services		Signed for Client	



GENIUS CLEANING SERVICES LLC-SPC

DATE:25.10.2025

ST.JOSEPH'S PRIVATE SCHOOL -ABU DHABI-UNDERGROUND WATER TANK-2

BEFORE CLEANING	AFTER CLEANING
	
	
	



Tel: 02-5559683, Fax: 02-5526433, P.O.Box : 132952, Abu Dhabi, UAE

E-mail: geniuscleaninguae@gmail.com



العبقرية لخدمات التنظيف GENIUS CLEANING SERVICES

Ref.No:1426/2025

Water Tank Cleaning Completion Certificate

Customer Name	ST.JOSEPH'S SCHOOL,ABU DHABI	Reported Date	26.10.2025
Contact Name	Mr. MARTIN	Contact No.	
Location : ST.JOSEPH'S SCHOOL			
Specification of Tank: DRINKING WATER COOLER 1,2,3,4&5		Disinfectant used: CARELA PLUS CARELA BIO	
☐ Concrete Uncoated ☐ Molded Fiber Glass GRP Panel ☒ Steel			
☐ Concrete Coated ☐ TILES ☐ P E ☐ Others			
Size of tank: 100 LTR			
Quantity of Water ☐ Full ☐ Half Full ☒ Empty			
Condition of Tank before Cleaning ☐ Clean ☒ Dirty ☐ Very Dirty			
Bio-Film ☐ Yes ☒ No		Sediment ☒ Yes ☐ No	
Mould / Algae ☐ Yes ☒ No		Stains ☒ Yes ☐ No	
Lid / Covers Fitted ☒ Yes ☐ No ☐ Damaged			
Leaks ☐ Yes ☒ No Vent Screen present Yes ☐ No ☐ N/A			
Vent Screens Installed ☐ Yes ☐ No ☐ N/A			
Pumps Working ☒ Yes ☐ No		Valves Working ☐ Yes ☐ No	
Pipes ☐ Galvanized ☐ UPVC ☐ Copper		Tank fitted with a Drain ☒ Yes ☐ No	
Access			
Ladder Inside ☒ Yes ☐ No Ladder Outside ☒ Yes ☐ No			
Team Members(Name)		Time Started	Time Finished
1.RENJITH		06.00 PM	07.00 PM
2.SUJITH			
3.AJITH			
4.RAJESH			
Cleaning and Disinfection carried out for the tank.			
Disinfection will be effective for 6 months from the date of execution of process depending on the conditions			
Last Date of cleaning	Current Date of cleaning	Next Date of cleaning	
	25.10.2025	24.04.2026	
Signed for Genius Cleaning Services		Signed for Client	






GENIUS CLEANING SERVICES LLC-SPC

DATE:25.10.2025

ST.JOSEPH'S PRIVATE SCHOOL -ABU DHABI-WATER COOLER 1,2,3

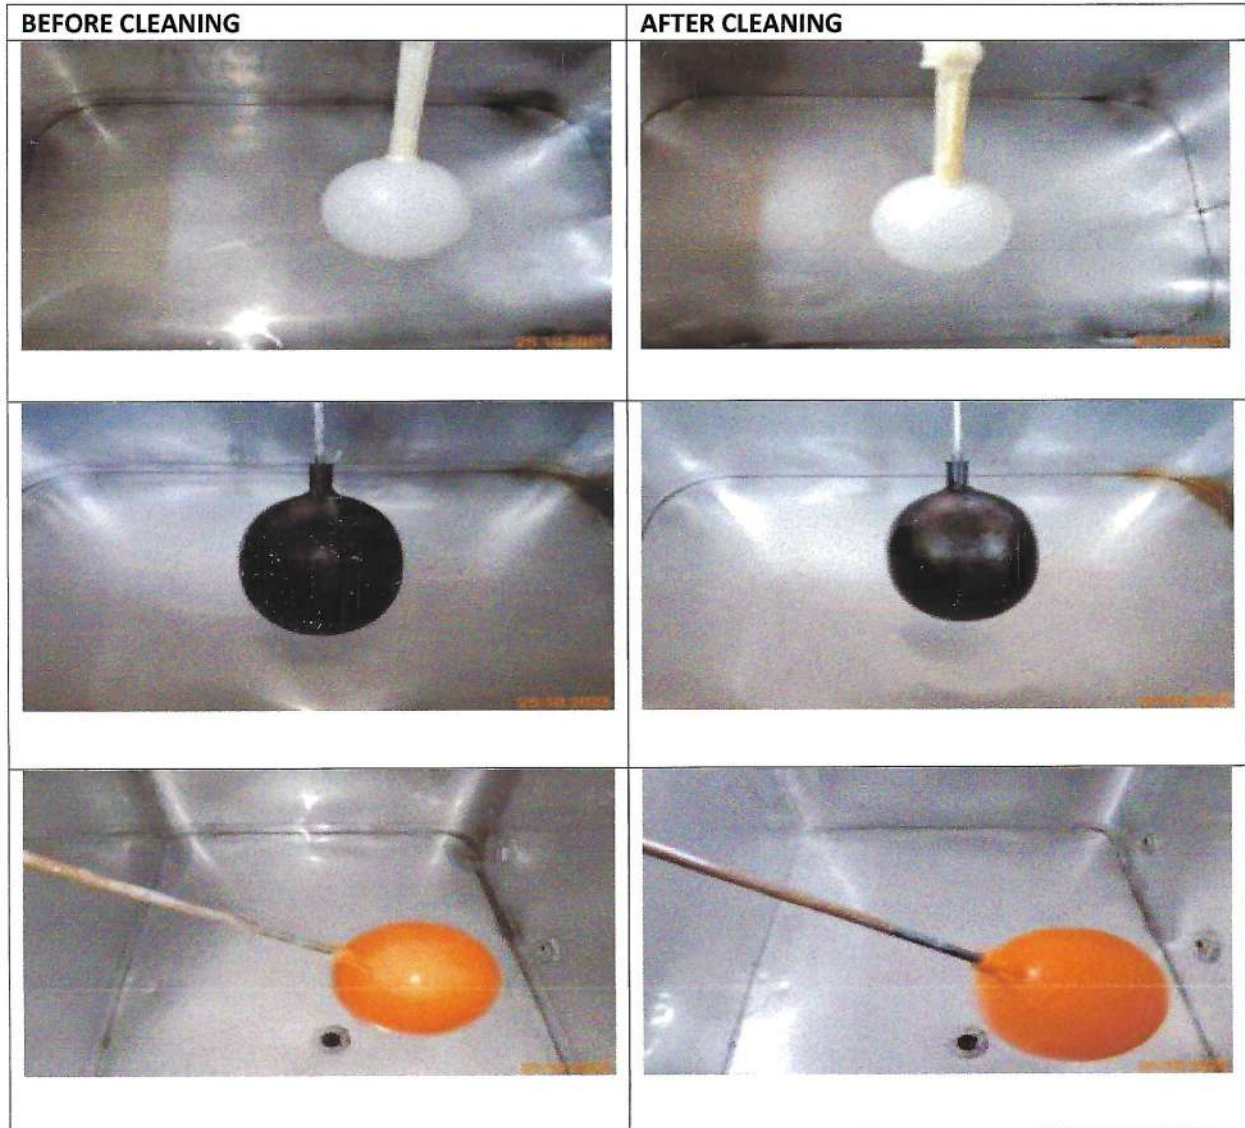

Tel: 02-5559683, Fax: 02-5526433, P.O.Box : 132952, Abu Dhabi, UAE


E-mail: geniuscleaninguae@gmail.com



GENIUS CLEANING SERVICES LLC-SPC

DATE:25.10.2025

ST.JOSEPH'S PRIVATE SCHOOL -ABU DHABI-WATER COOLER 4&5

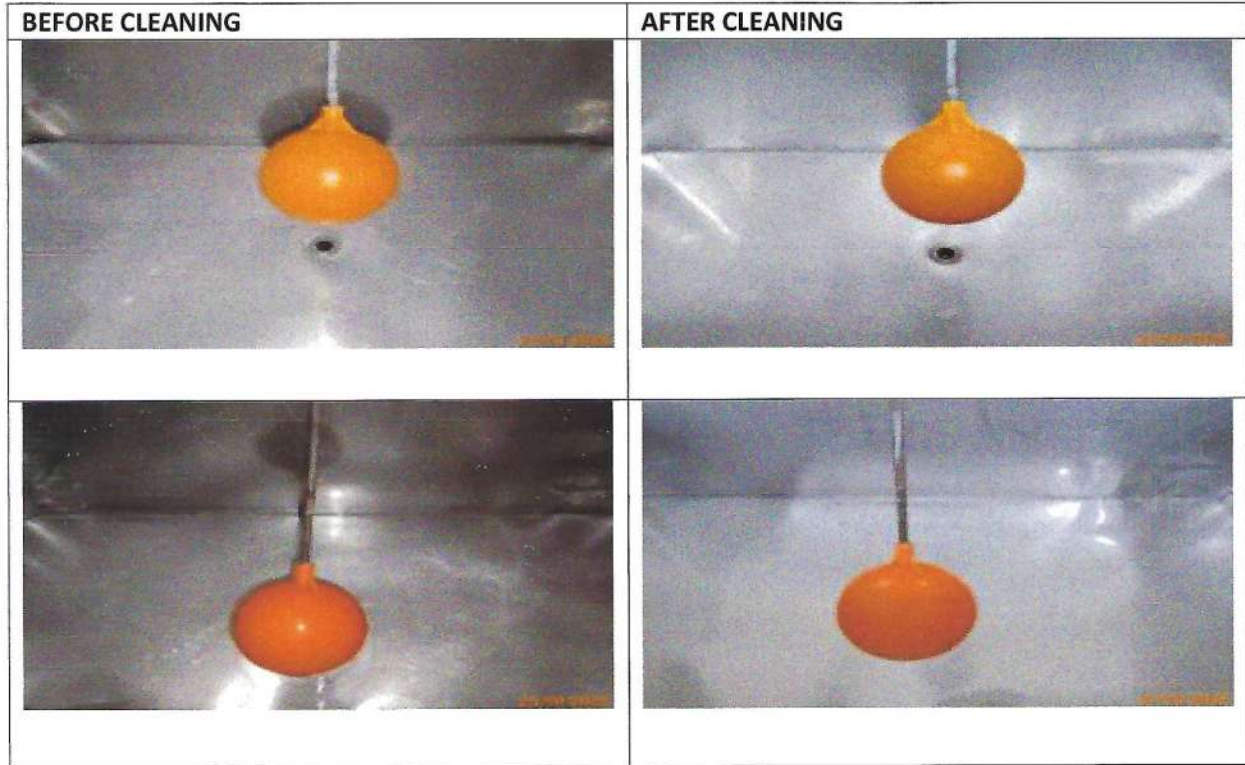

Tel: 02-5559683, Fax: 02-5526433, P.O.Box : 132952, Abu Dhabi, UAE

E-mail: geniuscleaninguae@gmail.com



TEST REPORT - MICROBIOLOGY

Customer Name : GENIUS CLEANING SERVICES - L.L.C - S.P.C
Address : P.O. Box: 132952, Abu Dhabi, United Arab Emirates
Contact person : Mr. Saji S. Pilai



Report no.: AR25-105731-1

Project : Quality Assurance

Project No. : -

Job No. : AJ25-041765

Contract/LPO No. : GCS/159/2025

Sample No. : AS25-105731

Project location : -

Report Date : 29/10/2025

Test location : AHSL - Abu Dhabi

Test Date : 27/10/2025-29/10/2025

Sample description : POTABLE WATER

Sampled by : Client representative

Sampling method : Not Specified

Source of sample : St Joseph's Private School, Abu Dhabi

Sampling location : St Joseph's Private School, Water Tank, Abu Dhabi

Sampling Cert. No : 71620/3

Sampling Date&Time : 27/10/2025 11:50 AM

On-site treatment : Transported in cool box

Collection Temp.(°C) : Not Specified

Receipt Temp.(°C) : 13.8

Received Date&Time : 27/10/2025 06:40 PM

Sample delivered by : Client representative

TEST RESULTS

Test Parameter	Test Method	Unit	MU	DL	Result	Limits	Remarks
Total Coliforms	^K APHA 9222 B; 24th Ed 2023	CFU/100mL	N/A	1	0	0 max.	Satisfactory
Fecal Coliforms	^K APHA 9221 E.1; 24th Ed 2023	CFU/100mL	N/A	1	0	0 max.	Satisfactory
<i>Escherichia coli</i>	^K APHA 9222 B; 24th Ed 2023	CFU/100mL	N/A	1	0	0 max.	Satisfactory
<i>Pseudomonas aeruginosa</i>	^K BS EN 16266: 2008	CFU/100mL	N/A	1	0	0 max.	Satisfactory
Fecal streptococci/Enterococci	^K APHA 9230 C; 24th Ed 2023	CFU/100mL	N/A	1	0	0 max.	Satisfactory

Tested by : EM00655, EM00830

Verified by : EM00530

Test Method Variations : None

Remarks : None

Specifications

The water Quality Regulations 2025, Department of Energy, Abu Dhabi

^KIndicates AHSL Abu Dhabi is accredited by ENAS (NAL 013) and EIAC (LB-TEST-023)

MU - Measurement of uncertainty. The reported expanded uncertainty is based on standard uncertainty multiplied by a coverage factor K=2, providing a level of confidence of approximately 95%.

DL - Detection Level: MDL (Method Detection Limit) and LOQ (Limit of Quantitation) are reported for Microbiology and Chemistry parameters respectively, unless otherwise stated.



B. Hariram

Approved by : Mr. Hariram Balaraman, HOD - Microbiological Dept.

THIS IS A COMPUTER GENERATED REPORT AND NO SIGNATURE REQUIRED

This report relates only to the sample tested and shall only be reproduced in full and with the written approval of AHS laboratories

TEST REPORT - LEGIONELLA

Customer Name : GENIUS CLEANING SERVICES - L.L.C - S.P.C
Address : P.O. Box: 132952, Abu Dhabi, United Arab Emirates
Contact person : Mr. Saji S. Pilai



Report no.: AR25-105731-2

Project : Quality Assurance

Project No. : -

Job No. : AJ25-041765

Contract/LPO No. : GCS/159/2025

Sample No. : AS25-105731

Project location : -

Report Date : 07/11/2025

Test location : AHSL - Abu Dhabi

Test Date : 28/10/2025-07/11/2025

Sample description : POTABLE WATER

Sampled by : Client representative

Sampling method : Not Specified

Source of sample : St Joseph's Private School, Abu Dhabi

Sampling location : St Joseph's Private School, Water Tank, Abu Dhabi

Sampling Cert. No : 71620/3

Sampling Date&Time : 27/10/2025 11:50 AM

On-site treatment : Transported in cool box

Collection Temp.(°C) : Not Specified

Receipt Temp.(°C) : 13.8

Received Date&Time : 27/10/2025 06:40 PM

Sample delivered by : Client representative

TEST RESULTS

Test Parameter	Test Method	Unit	MU	DL	Result	Limits	Remarks
Legionella sp.	K ISO 11731: 2017 (Matrix A/ Procedure 7/ Medium C)	CFU/L	NA	1	< 1	<1	Satisfactory

Tested by : EM00919

Verified by : EM00362

Test Method Variations : None

Remarks : None

Specifications

The water Quality Regulations 2025, Department of Energy, Abu Dhabi

K Indicates AHSL Abu Dhabi is accredited by ENAS (NAL 013) and ELAC (LB-TEST-023)

MU - Measurement of uncertainty. The reported expanded uncertainty is based on standard uncertainty multiplied by a coverage factor K=2, providing a level of confidence of approximately 95%.

DL - Detection Level: MDL (Method Detection Limit) and LOQ (Limit of Quantitation) are reported for Microbiology and Chemistry parameters respectively, unless otherwise stated.



B. Hariram

Approved by : Mr. Hariram Balaraman, HOD - Microbiological Dept.

THIS IS A COMPUTER GENERATED REPORT AND NO SIGNATURE REQUIRED

This report relates only to the sample tested and shall only be reproduced in full and with the written approval of AHS laboratories

TR/CM G3/Rev00

Page 1 of 1

Report no.: AR25-105731-2

ABU DHABI, U.A.E.
P.O. BOX 31039
TEL.: (02) 5542234

DUBAI, U.A.E.
P.O. BOX 16756
TEL.: (04) 3472201

JEBEL ALI, U.A.E.
P.O. BOX 16756
TEL.: (04) 8818461

RAS AL KHAIMAH, U.A.E.
P.O. BOX 34987
TEL.: (07) 2432328

KALBA, SHARJAH, U.A.E.
P.O. BOX 145133
TEL.: (09) 2779543

ALAIN, U.A.E.
P.O. BOX 31039
TEL.: (03) 7343093