

WATER TANK CLEANING & DISINFECTION

@

ST. JOSEPH'S SCHOOL



GENIUS CLEANING SERVICES

**REPORT
TO**

ST JOSEPH'S SCHOOL, ABU DHABI, UAE

DATE OF CLEANING: 27.04.2024

NEXT CLEANING: 26.10.2024

Prepared By
Genius Cleaning Services
Abu Dhabi
0529287635



العبقرية لخدمات التنظيف GENIUS CLEANING SERVICES

CLEANING & DISINFECTION CERTIFICATE

POTABLE WATER TANKS

CLIENT NAME	:ST JOSEPH'S SCHOOL
CLIENT ADDRESS	:ABU DHABI,UAE
CONTACT PERSON	:Mr : MARTIN
SITE DETAILS	:ST JOSEPH'S SCHOOL
SERVICE DETAILS	:WATER TANK CLEANING&DISINFECTION
DATE OF CLEANING	:27 APRIL 2024
FREQUENCY OF CLEANING	:EVERY SIX MONTHS
DATE OF NEXT CLEANING	:26 OCTOBER 2024

The procedures employed in this cleaning and disinfection comply with HS (G)70 health and safety guidelines for prevention of Legionella as well as BS6700 and CARELA BIO LUS method statement.

The entire water storage Tank (TANK-03 Nos& COOLER-05 Nos) should be cleaned and disinfected minimum every six (6)months depending upon the conditions.



GENIUS CLEANING SERVICES

TRN : 100213130600003

Tel: 02 5559683, Mob: 052 928 7635. P.O.Box : 133654, Abu Dhabi, UAE

Email: mail@geniuscleaninguae.com, geniuscleaninguae@gmail.com

Web site: www.geniuscleaninguae.com





العبقرية لخدمات التنظيف GENIUS CLEANING SERVICES

Ref.No:531

Water Tank Cleaning Completion Certificate

Customer Name	ST.JOSEPH'S SCHOOL,ABU DHABI	Reported Date	28.04.2024
Contact Name	Mr. MARTIN	Contact No.	
Location : ST.JOSEPH'S SCHOOL			
Specification of Tank: UNDER GROUND WATER TANK		Disinfectant used: CARELA PLUS CARELA BIO	
<input type="checkbox"/> Concrete Uncoated <input type="checkbox"/> Molded Fiber Glass <input type="checkbox"/> GRP Panel <input type="checkbox"/> Steel			
<input checked="" type="checkbox"/> Concrete Coated <input type="checkbox"/> TILES <input type="checkbox"/> P E <input type="checkbox"/> Others			
Size of tank: 33M3			
Quantity of Water <input type="checkbox"/> Full <input type="checkbox"/> Half Full <input checked="" type="checkbox"/> Empty			
Condition of Tank before Cleaning <input type="checkbox"/> Clean <input checked="" type="checkbox"/> Dirty <input type="checkbox"/> Very Dirty			
Bio-Film <input type="checkbox"/> Yes <input checked="" type="checkbox"/> No		Sediment <input checked="" type="checkbox"/> Yes <input type="checkbox"/> No	
Mould / Algae <input type="checkbox"/> Yes <input checked="" type="checkbox"/> No		Stains <input checked="" type="checkbox"/> Yes <input type="checkbox"/> No	
Lid / Covers Fitted <input checked="" type="checkbox"/> Yes <input type="checkbox"/> No <input type="checkbox"/> Damaged			
Leaks <input type="checkbox"/> Yes <input checked="" type="checkbox"/> No Vent Screen present Yes <input type="checkbox"/> No <input type="checkbox"/> N/A			
Vent Screens Installed <input type="checkbox"/> Yes <input type="checkbox"/> No <input type="checkbox"/> N/A			
Pumps Working <input checked="" type="checkbox"/> Yes <input type="checkbox"/> No		Valves Working <input type="checkbox"/> Yes <input type="checkbox"/> No	
Pipes <input type="checkbox"/> Galvanized <input type="checkbox"/> UPVC <input type="checkbox"/> Copper		Tank fitted with a Drain <input checked="" type="checkbox"/> Yes <input type="checkbox"/> No	
Access			
Ladder Inside <input checked="" type="checkbox"/> Yes <input type="checkbox"/> No Ladder Outside <input checked="" type="checkbox"/> Yes <input type="checkbox"/> No			
Team Members(Name)		Time Started	Time Finished
1.SAJI		08.00 AM	11.00 AM
2.SANTHOSH			
3.UNNI			
Cleaning and Disinfection carried out for the tank. Disinfection will be effective for 6 months from the date of execution of process depending on the conditions			
Last Date of cleaning		Current Date of cleaning	Next Date of cleaning
		27.04.2024	26.10.2024
Signed for Genius Cleaning Services		Signed for Client	



TRN : 100213130600003

Tel: 02 5559683, Mob: 052 928 7635. P.O.Box : 133654, Abu Dhabi, UAE

Email: mail@geniuscleaninguae.com, geniuscleaninguae@gmail.com

Web site: www.geniuscleaninguae.com





GENIUS CLEANING SERVICES

DATE: 27.04.2024

ST. JOSEPH'S SCHOOL - ABU DHABI - UNDERGROUND WATER TANK

BEFORE CLEANING	AFTER CLEANING
	
	
	



Tel: 02-5559683, Fax: 02-5526433, P.O.Box : 132952, Abu Dhabi, UAE

E-mail: geniuscleaninguae@gmail.com




العبقرية لخدمات التنظيف GENIUS CLEANING SERVICES

Ref.No:532

Water Tank Cleaning Completion Certificate

Customer Name	ST.JOSEPH'S SCHOOL,ABU DHABI	Reported Date	28.04.2024
Contact Name	Mr. MARTIN	Contact No.	
Location : ST.JOSEPH'S SCHOOL			
Specification of Tank: ROOF TOP WATER TANK -1		Disinfectant used: CARELA PLUS CARELA BIO	
<input type="checkbox"/> Concrete Uncoated <input type="checkbox"/> Molded Fiber Glass <input checked="" type="checkbox"/> GRP Panel <input type="checkbox"/> Steel			
<input type="checkbox"/> Concrete Coated <input type="checkbox"/> TILES <input type="checkbox"/> P E <input type="checkbox"/> Others			
Size of tank: 10 M3			
Quantity of Water <input type="checkbox"/> Full <input type="checkbox"/> Half Full <input checked="" type="checkbox"/> Empty			
Condition of Tank before Cleaning <input type="checkbox"/> Clean <input checked="" type="checkbox"/> Dirty <input type="checkbox"/> Very Dirty			
Bio-Film <input type="checkbox"/> Yes <input checked="" type="checkbox"/> No		Sediment <input checked="" type="checkbox"/> Yes <input type="checkbox"/> No	
Mould / Algae <input type="checkbox"/> Yes <input checked="" type="checkbox"/> No		Stains <input checked="" type="checkbox"/> Yes <input type="checkbox"/> No	
Lid / Covers Fitted <input checked="" type="checkbox"/> Yes <input type="checkbox"/> No <input type="checkbox"/> Damaged			
Leaks <input type="checkbox"/> Yes <input checked="" type="checkbox"/> No		Vent Screen present Yes <input type="checkbox"/> No <input type="checkbox"/> N/A	
Vent Screens Installed <input type="checkbox"/> Yes <input type="checkbox"/> No <input type="checkbox"/> N/A			
Pumps Working <input checked="" type="checkbox"/> Yes <input type="checkbox"/> No		Valves Working <input type="checkbox"/> Yes <input type="checkbox"/> No	
Pipes <input type="checkbox"/> Galvanized <input type="checkbox"/> UPVC <input type="checkbox"/> Copper		Tank fitted with a Drain <input checked="" type="checkbox"/> Yes <input type="checkbox"/> No	
Access			
Ladder Inside <input checked="" type="checkbox"/> Yes <input type="checkbox"/> No		Ladder Outside <input checked="" type="checkbox"/> Yes <input type="checkbox"/> No	
Team Members(Name)		Time Started	Time Finished
1.SAJI		11.00 AM	12. 00 PM
2.SANTHOSH			
3.UNNI			
Cleaning and Disinfection carried out for the tank. Disinfection will be effective for 6 months from the date of execution of process depending on the conditions			
Last Date of cleaning	Current Date of cleaning	Next Date of cleaning	
	27.04.2024	26.10.2024	
Signed for Genius Cleaning Services		Signed for Client	



TRN : 100213130600003

Tel: 02 5559683, Mob: 052 928 7635. P.O.Box : 133654, Abu Dhabi, UAE

Email: mail@geniuscleaninguae.com, geniuscleaninguae@gmail.com

Web site: www.geniuscleaninguae.com











GENIUS CLEANING SERVICES

DATE:27.04.2024

ST.JOSEPH'S SCHOOL - ABU DHABI – ROOFTOP WATER TANK NO 1

BEFORE CLEANING	AFTER CLEANING
	
	
	

Tel: 02-5559683, Fax: 02-5526433, P.O.Box : 132952, Abu Dhabi, UAE

E-mail: geniuscleaninguae@gmail.com





العبقرية لخدمات التنظيف GENIUS CLEANING SERVICES

Ref.No:533

Water Tank Cleaning Completion Certificate

Customer Name	ST.JOSEPH'S SCHOOL,ABU DHABI	Reported Date	28.04.2024
Contact Name	Mr. MARTIN	Contact No.	
Location : ST.JOSEPH'S SCHOOL			
Specification of Tank: ROOF TOP WATER TANK -2		Disinfectant used: CARELA PLUS CARELA BIO	
<input type="checkbox"/> Concrete Uncoated	<input type="checkbox"/> Molded Fiber Glass	<input checked="" type="checkbox"/> GRP Panel	<input type="checkbox"/> Steel
<input type="checkbox"/> Concrete Coated	<input type="checkbox"/> TILES	<input type="checkbox"/> P E	<input type="checkbox"/> Others
Size of tank: 10 M3			
Quantity of Water	<input type="checkbox"/> Full	<input type="checkbox"/> Half Full	<input checked="" type="checkbox"/> Empty
Condition of Tank before Cleaning	<input type="checkbox"/> Clean	<input checked="" type="checkbox"/> Dirty	<input type="checkbox"/> Very Dirty
Bio-Film	<input type="checkbox"/> Yes	<input checked="" type="checkbox"/> No	Sediment <input checked="" type="checkbox"/> Yes <input type="checkbox"/> No
Mould / Algae	<input type="checkbox"/> Yes	<input checked="" type="checkbox"/> No	Stains <input checked="" type="checkbox"/> Yes <input type="checkbox"/> No
Lid / Covers Fitted	<input checked="" type="checkbox"/> Yes	<input type="checkbox"/> No	<input type="checkbox"/> Damaged
Leaks	<input type="checkbox"/> Yes	<input checked="" type="checkbox"/> No	Vent Screen present Yes <input type="checkbox"/> No <input type="checkbox"/> N/A
Vent Screens Installed	<input type="checkbox"/> Yes	<input type="checkbox"/> No	<input type="checkbox"/> N/A
Pumps Working	<input checked="" type="checkbox"/> Yes	<input type="checkbox"/> No	Valves Working <input type="checkbox"/> Yes <input type="checkbox"/> No
Pipes <input type="checkbox"/> Galvanized <input type="checkbox"/> UPVC <input type="checkbox"/> Copper	Tank fitted with a Drain <input checked="" type="checkbox"/> Yes <input type="checkbox"/> No		
Access			
Ladder Inside	<input checked="" type="checkbox"/> Yes	<input type="checkbox"/> No	Ladder Outside <input checked="" type="checkbox"/> Yes <input type="checkbox"/> No
Team Members(Name)	Time Started	Time Finished	
1.SAJI	12.00 PM	01. 00 PM	
2.SANTHOSH			
3.UNNI			
Cleaning and Disinfection carried out for the tank. Disinfection will be effective for 6 months from the date of execution of process depending on the conditions			
Last Date of cleaning	Current Date of cleaning	Next Date of cleaning	
	27.04.2024	26.10.2024	
Signed for Genius Cleaning Services		Signed for Client	

TRN : 100213130600003

Tel: 02 5559683, Mob: 052 928 7635. P.O.Box : 133654, Abu Dhabi, UAE

Email: mail@geniuscleaninguae.com, geniuscleaninguae@gmail.com

Web site: www.geniuscleaninguae.com

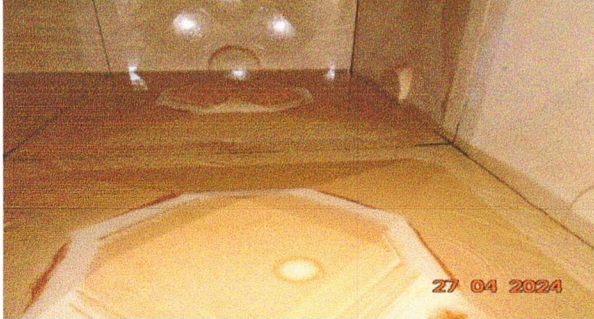



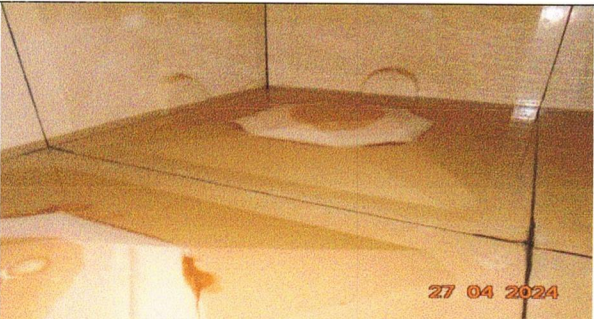
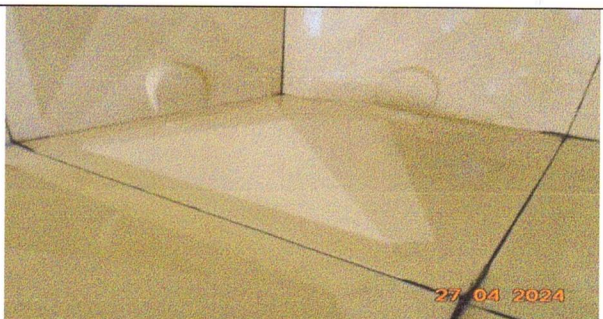




GENIUS CLEANING SERVICES

DATE:27.04.2024

ST.JOSEPH'S SCHOOL - ABU DHABI – ROOFTOP WATER TANK NO 2

BEFORE CLEANING	AFTER CLEANING
 27 04 2024	 27 04 2024
 27 04 2024	 27 04 2024
 27 04 2024	 27 04 2024

Tel: 02-5559683, Fax: 02-5526433, P.O.Box : 132952, Abu Dhabi, UAE

E-mail: geniuscleaninguae@gmail.com





العبقرية لخدمات التنظيف GENIUS CLEANING SERVICES

Ref.No:534

Water Tank Cleaning Completion Certificate

Customer Name	ST.JOSEPH'S SCHOOL,ABU DHABI	Reported Date	28.04.2024
Contact Name	Mr. MARTIN	Contact No.	
Location : ST.JOSEPH'S SCHOOL			
Specification of Tank:DRINKING WATER COOLER-1,2,3		Disinfectant used: CARELA PLUS CARELA BIO	
<input type="checkbox"/> Concrete Uncoated <input type="checkbox"/> Molded Fiber Glass <input type="checkbox"/> GRP Panel <input checked="" type="checkbox"/> Steel			
<input type="checkbox"/> Concrete Coated <input type="checkbox"/> TILES <input type="checkbox"/> P E <input type="checkbox"/> Others			
Size of tank: 100 LTR			
Quantity of Water <input type="checkbox"/> Full <input type="checkbox"/> Half Full <input checked="" type="checkbox"/> Empty			
Condition of Tank before Cleaning <input type="checkbox"/> Clean <input checked="" type="checkbox"/> Dirty <input type="checkbox"/> Very Dirty			
Bio-Film <input type="checkbox"/> Yes <input checked="" type="checkbox"/> No		Sediment <input checked="" type="checkbox"/> Yes <input type="checkbox"/> No	
Mould / Algae <input type="checkbox"/> Yes <input checked="" type="checkbox"/> No		Stains <input checked="" type="checkbox"/> Yes <input type="checkbox"/> No	
Lid / Covers Fitted <input checked="" type="checkbox"/> Yes <input type="checkbox"/> No <input type="checkbox"/> Damaged			
Leaks <input type="checkbox"/> Yes <input checked="" type="checkbox"/> No		Vent Screen present Yes <input type="checkbox"/> No <input type="checkbox"/> N/A	
Vent Screens Installed <input type="checkbox"/> Yes <input type="checkbox"/> No <input type="checkbox"/> N/A			
Pumps Working <input checked="" type="checkbox"/> Yes <input type="checkbox"/> No		Valves Working <input type="checkbox"/> Yes <input type="checkbox"/> No	
Pipes <input type="checkbox"/> Galvanized <input type="checkbox"/> UPVC <input type="checkbox"/> Copper		Tank fitted with a Drain <input checked="" type="checkbox"/> Yes <input type="checkbox"/> No	
Access			
Ladder Inside <input checked="" type="checkbox"/> Yes <input type="checkbox"/> No		Ladder Outside <input checked="" type="checkbox"/> Yes <input type="checkbox"/> No	
Team Members(Name)		Time Started	Time Finished
1.SAJI		01.00 PM	02. 30 PM
2.SANTHOSH			
3.UNNI			
Cleaning and Disinfection carried out for the tank. Disinfection will be effective for 6 months from the date of execution of process depending on the conditions			
Last Date of cleaning	Current Date of cleaning	Next Date of cleaning	
	27.04.2024	26.10.2024	
Signed for Genius Cleaning Services		Signed for Client	

TRN : 100213130600003

Tel: 02 5559683, Mob: 052 928 7635. P.O.Box : 133654, Abu Dhabi, UAE

Email: mail@geniuscleaninguae.com, geniuscleaninguae@gmail.com

Web site: www.geniuscleaninguae.com

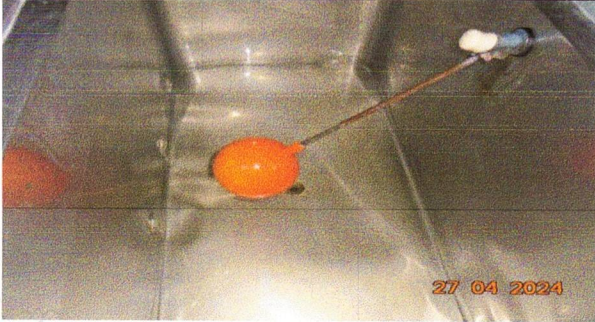
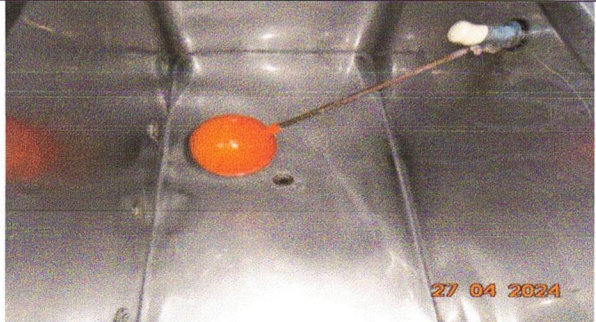
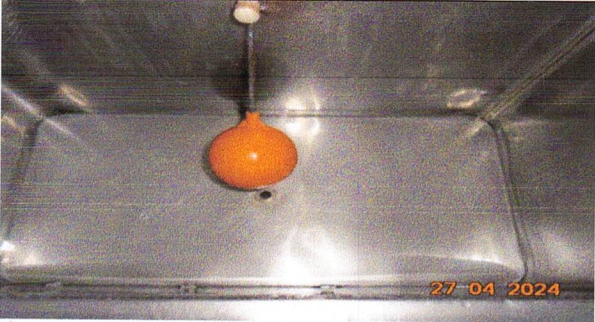
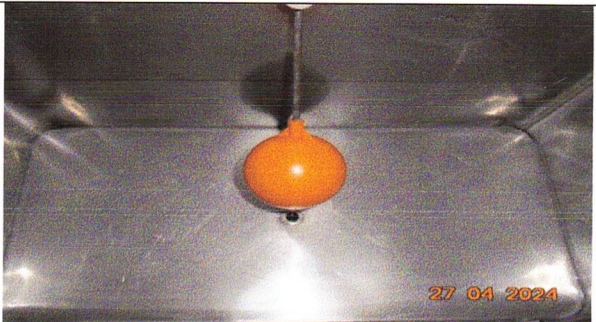
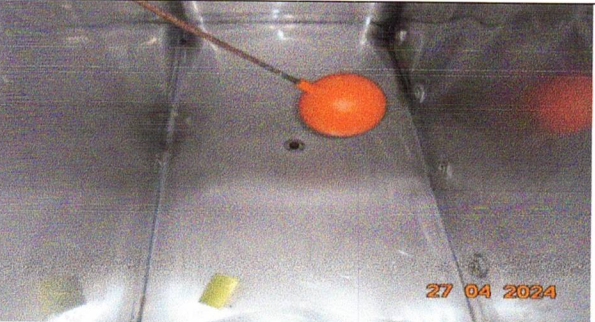
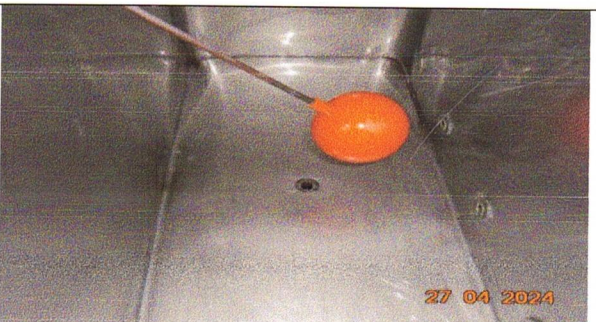




GENIUS CLEANING SERVICES

DATE:27.04.2024

ST.JOSEPH'S SCHOOL - ABU DHABI – DRINKING WATER COOLER 1,2,3

BEFORE CLEANING	AFTER CLEANING
	
	
	



Tel: 02-5559683, Fax: 02-5526433, P.O.Box : 132952, Abu Dhabi, UAE

E-mail: geniuscleaninguae@gmail.com



العبقرية لخدمات التنظيف GENIUS CLEANING SERVICES

Ref.No:536

Water Tank Cleaning Completion Certificate

Customer Name	ST.JOSEPH'S SCHOOL,ABU DHABI	Reported Date	28.04.2024
Contact Name	Mr. MARTIN	Contact No.	
Location : ST.JOSEPH'S SCHOOL			
Specification of Tank:DRINKING WATER COOLER-4,5		Disinfectant used: CARELA PLUS CARELA BIO	
<input type="checkbox"/> Concrete Uncoated <input type="checkbox"/> Molded Fiber Glass <input type="checkbox"/> GRP Panel <input checked="" type="checkbox"/> Steel			
<input type="checkbox"/> Concrete Coated <input type="checkbox"/> TILES <input type="checkbox"/> P E <input type="checkbox"/> Others			
Size of tank: 100 LTR			
Quantity of Water <input type="checkbox"/> Full <input type="checkbox"/> Half Full <input checked="" type="checkbox"/> Empty			
Condition of Tank before Cleaning <input type="checkbox"/> Clean <input checked="" type="checkbox"/> Dirty <input type="checkbox"/> Very Dirty			
Bio-Film <input type="checkbox"/> Yes <input checked="" type="checkbox"/> No		Sediment <input checked="" type="checkbox"/> Yes <input type="checkbox"/> No	
Mould / Algae <input type="checkbox"/> Yes <input checked="" type="checkbox"/> No		Stains <input checked="" type="checkbox"/> Yes <input type="checkbox"/> No	
Lid / Covers Fitted <input checked="" type="checkbox"/> Yes <input type="checkbox"/> No <input type="checkbox"/> Damaged			
Leaks <input type="checkbox"/> Yes <input checked="" type="checkbox"/> No Vent Screen present Yes <input type="checkbox"/> No <input type="checkbox"/> N/A			
Vent Screens Installed <input type="checkbox"/> Yes <input type="checkbox"/> No <input type="checkbox"/> N/A			
Pumps Working <input checked="" type="checkbox"/> Yes <input type="checkbox"/> No Valves Working <input type="checkbox"/> Yes <input type="checkbox"/> No			
Pipes <input type="checkbox"/> Galvanized <input type="checkbox"/> UPVC <input type="checkbox"/> Copper		Tank fitted with a Drain <input checked="" type="checkbox"/> Yes <input type="checkbox"/> No	
Access			
Ladder Inside <input checked="" type="checkbox"/> Yes <input type="checkbox"/> No Ladder Outside <input checked="" type="checkbox"/> Yes <input type="checkbox"/> No			
Team Members(Name)		Time Started	Time Finished
1.SAJI		02.30 PM	03. 30 PM
2.SANTHOSH			
3.UNNI			
<i>Cleaning and Disinfection carried out for the tank.</i>			
<i>Disinfection will be effective for 6 months from the date of execution of process depending on the conditions</i>			
Last Date of cleaning	Current Date of cleaning	Next Date of cleaning	
	27.04.2024	26.10.2024	
Signed for Genius Cleaning Services		Signed for Client	

TRN : 100213130600003

Tel: 02 5559683, Mob: 052 928 7635. P.O.Box : 133654, Abu Dhabi, UAE

Email: mail@geniuscleaninguae.com, geniuscleaninguae@gmail.com

Web site: www.geniuscleaninguae.com



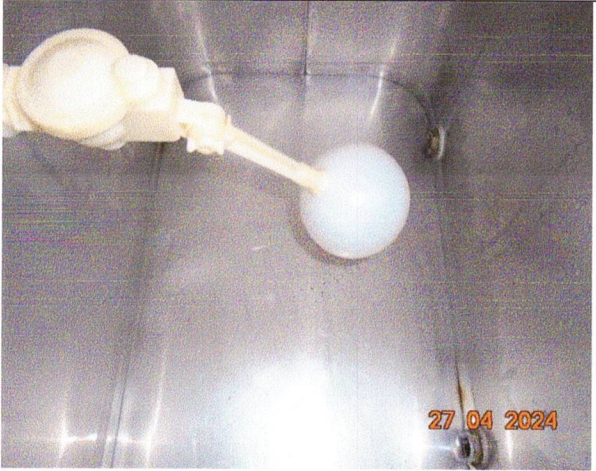
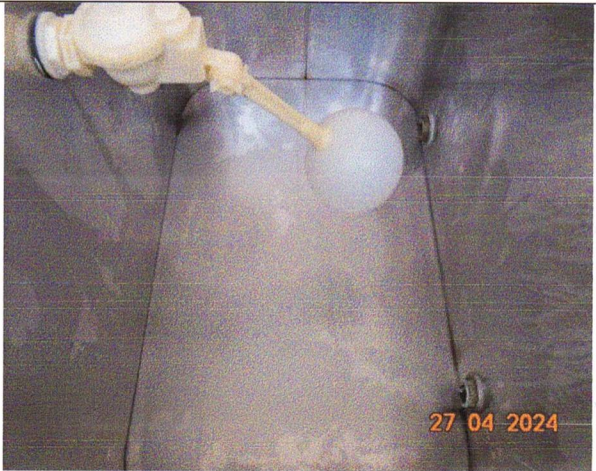




GENIUS CLEANING SERVICES

DATE: 27.04.2024

ST. JOSEPH'S SCHOOL - ABU DHABI - DRINKING WATER COOLER 4,5

BEFORE CLEANING	AFTER CLEANING
	
	



Tel: 02-5559683, Fax: 02-5526433, P.O.Box: 132952, Abu Dhabi, UAE

E-mail: geniuscleaninguae@gmail.com